

Seasonal Progress Report #23

SR431 Treatment Vault Effectiveness Monitoring

Agreement Number: P367-18-018

Submitted by: Tahoe Resource Conservation District

Submitted to: Nevada Department of Transportation

Current Contract Term: July 1, 2023 – June 30, 2025

Water Year: 2023

Period: Summer Season, June 1, 2023 –September 30, 2023

Submission Date: October 31, 2023

Two stormwater filter vaults, a Contech Media Filtration System (MFS) and a Jellyfish Filter, were installed by the Nevada Department of Transportation (NDOT) on State Highway 431 (SR431) above Incline Village, Nevada in 2013. Monitoring equipment was installed at the inflows and outflows of these two vaults. The Tahoe Resource Conservation District (Tahoe RCD) continued the effectiveness monitoring efforts of the Desert Research Institute (DRI) at the four monitoring stations on May 1, 2015 and will continue to monitor through the spring of water year 2025 (May 31, 2025) and beyond if funding allows. A new contract was executed for July 1, 2023 - June 30, 2025 to allow for this. Tahoe RCD follows sampling protocols outlined in the Regional Stormwater Monitoring Program Framework and Implementation Guidance document (RSWMP FIG Update, Tahoe RCD et al 2017). Tahoe RCD appreciates the opportunity to provide these water quality monitoring services for NDOT and looks forward to continuing the partnership.

Tasks and subtasks associated with this project and a summary of work completed to date are described below. Table 1 provides a summary of tasks, due dates and percent completion to date for the current agreement. ASWMR refers to the Annual Stormwater Monitoring Report submitted each year to the Nevada Division of Environmental Protection (NDEP) on March 31st as part of the IMP partnership.

Table 1 Summary of tasks, due dates, and percent completion to date.

Task	Description	Due Date	% Of Work Complete	Date Submitted
1	Project Administration			
1.1	Quarterly Invoices	10/31/21, 1/31/22, 4/30/22, 7/31/22, 10/31/22, 1/31/23, 4/30/23, 7/31/23, 10/31/23	ongoing	11/8/21, 3/23/22, 6/17/22, 7/28/22, 2/23/23, 5/31/23, 7/20/23
1.2	Seasonal Progress Reports	10/31/21, 3/31/22, 6/30/22, 10/31/22, 3/31/23, 6/30/23, 10/31/23	ongoing	11/5/21, 3/31/22, 6/30/22, 10/31/22, 4/19/23, 6/15/23, 10/31/23
2	Stormwater Monitoring			
2.1	Collect continuous flow and turbidity data at four monitoring stations	5/31/2023	ongoing	Available on Acuity
2.2	Collect stormwater runoff samples during eight events per year	5/31/2023	ongoing	NA
2.3	Collect three diurnal non-event snowmelt events if conditions allow	5/31/2023	ongoing	NA
2.4	Collect flow bypass data in both vaults	5/31/2023	ongoing	Available in Seasonal Progress Reports
2.5	Provide precipitation data to date	5/31/2023	ongoing	Available in Seasonal Progress Reports
2.6	Provide hydrograph, turbidity, and sample distribution graphs to date	5/31/2023	ongoing	Available in Seasonal Progress Reports
3	Condition Assessments			
3.1	Estimate Road RAM score prior to eight sampled events	Discontinued as of June 1, 2021	100%	NA
3.2	Measure depth of sediment in both vaults after sampled events	5/31/2023	ongoing	Available in Seasonal Progress Reports
4	Final Report			
4.1	Provide raw data	3/31/2022, 3/31/2023	ongoing	ASWMR
4.2	Provide treatment effectiveness analysis	3/31/2022, 3/31/2023	ongoing	ASWMR
4.3	Correlate Road RAM score to pollutant concentration and load	Discontinued WY20	100%	ASWMR
4.4	Provide mass loading v. volume calculations for select events	6/30/2016	100%	3/31/16, 6/30/16

Task 1: Project Administration

1. Invoices

Quarterly invoices will be submitted for this project covering the following periods:

- 1) July 1, 2023 - September 30, 2023 (due October 31, 2023)
- 2) October 1, 2023 - December 31, 2023 (due January 31, 2024)
- 3) January 1, 2024 - March 31, 2024 (due April 30, 2024)
- 4) April 1, 2024 - June 30, 2024 (due July 31, 2024)
- 5) July 1, 2024 - September 30, 2024 (due October 31, 2024)
- 6) October 1, 2024 - December 31, 2024 (due January 31, 2025)
- 7) January 1, 2025 - March 31, 2025 (due April 30, 2025)
- 8) April 1, 2025 - June 30, 2025 (due July 31, 2025)

2. Progress Reports

Progress reports are not concurrent with quarterly invoices. Seasonal progress reports will be submitted for this project covering the following periods (report number is consistent with prior agreement's reports beginning May 2015):

- #23: Summer: June 1, 2023 - September 30, 2023 (due October 31, 2023)
- #24: Fall/winter: October 1, 2023 - February 28, 2024 (due March 31, 2024)
- #25: Spring: March 1, 2024 - May 31, 2024 (due June 30, 2024)
- #26: Summer: June 1, 2024 - September 30, 2024 (due October 31, 2024)
- #27: Fall/winter: October 1, 2024 - February 29, 2025 (due March 31, 2025)
- #28: Spring: March 1, 2025 - May 31, 2025 (due June 30, 2025)

Please accept this report as seasonal progress report #23 for the summer season of water year 2023.

Task 2: Stormwater Monitoring

1. Maintain four stormwater monitoring stations to collect continuous flow and turbidity data

The summer season of WY23 began on June 1, 2023 and ended September 30, 2023. Continuous flow and turbidity were successfully monitored for the spring season at all sites. However, on September 15, 2023, a Ford F350 hit the weather station and the Jobbox containing data loggers and batteries for the monitoring equipment. All data collection ceased as of 9/15/2023 05:25.

See Figure 1- Figure 4 for photos of the accident that required the monitoring site to be rebuilt.



Figure 1 Location of old Jobbox, all cables ripped off.



Figure 2 Inside of Jobbox, batteries and dataloggers covered in battery acid.



Figure 3 Meteorological station with tipping bucket ripped down.



Figure 4 New Jobbox installed September 26, 2023.

2. Collect stormwater runoff samples at four monitoring sites during eight runoff events per year

During the summer season, three events were successfully sampled at Contech Inflow (CI), Jellyfish Inflow (JI), Jellyfish Outflow (JO), and Contech Outflow (JO), (a thunderstorm on June 10, 2023, a thunderstorm on August 19, 2023 and a frontal rain storm on August 20-21, 2023). Typically 6-12 samples should be taken per event at each site, however due to low flow and brief periods of flow, less than 6 samples were collected during the August 19, 2023 thunderstorm at all sites (see Appendix A, Figure 11-Figure 26 at the end of this report for hydrographs, continuous turbidity, and sample distributions for the events sampled). The successful samples were composited and sent to the lab for analysis. This brings the water year total to ten sampled events at Contech Inflow, Jellyfish Outflow, and Contech Outflow and nine sampled events for Jellyfish Inflow.

3. If conditions allow for non-event snowmelt sampling, analyze one composite consisting of three diurnals (counts as one of the eight events)

Non-event snowmelt did not occur in the summer season.

4. Install a pressure transducer in each treatment vault to identify when there is bypass flow

New pressure transducers were installed in June 2016 and linked to the remote access data management system currently used at the SR431 monitoring site. Data indicate that during the summer of WY23 the Contech MFS cartridge filters bypassed four times (on June 10, 2023, June 11, 2023 and June 22, 2023 during thunderstorm events, and on August 22, 2023 during a rain event) and the Jellyfish filters were bypassed one time (on June 10, 2023 during a thunderstorm event) (Figure 5 & Figure 6).

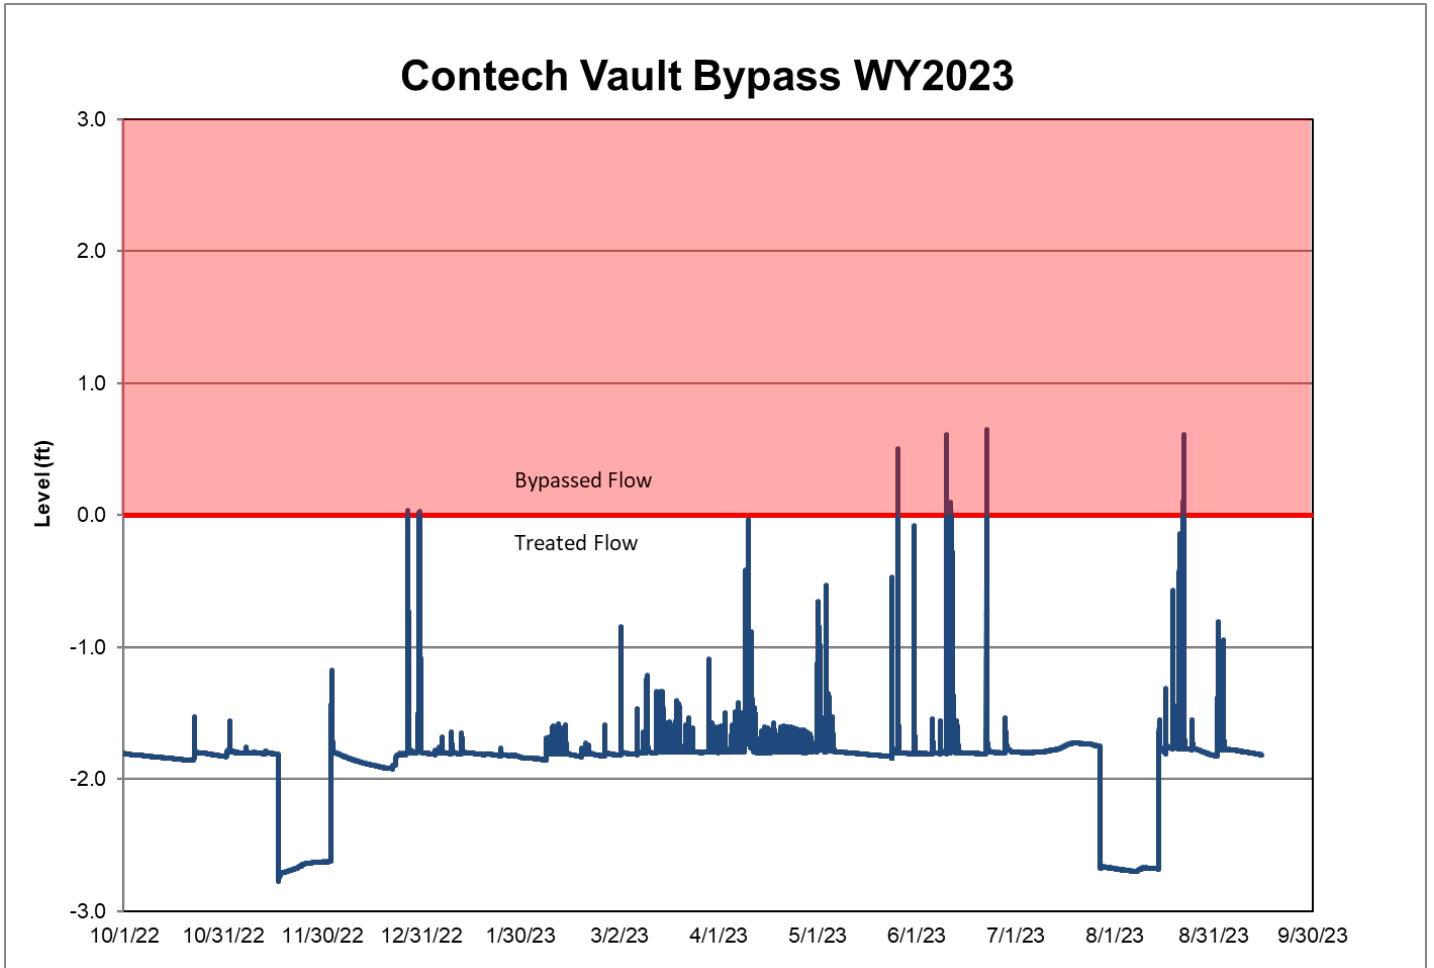


Figure 5 Bypassed flow in the Contech MFS vault for WY23.

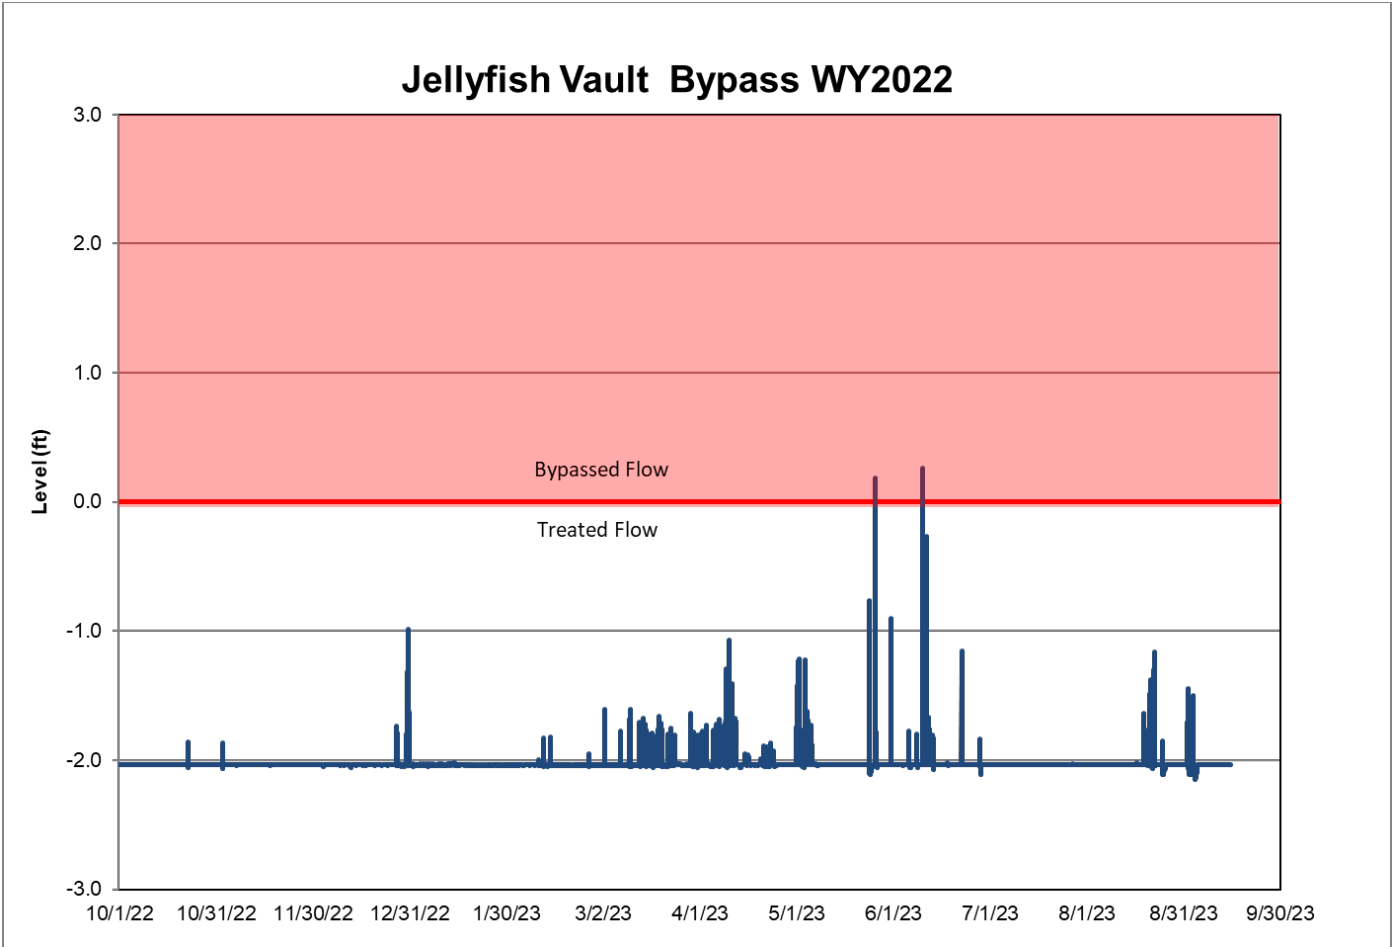


Figure 6 Bypassed flow in the Jellyfish vault for WY23.

5. Provide precipitation data to date

Table 2 provides summary data for all 53 fall/winter, spring, and summer WY23 precipitation events recorded at the NDOT meteorological station including event start and end dates, total precipitation, peak precipitation, minimum and maximum temperature, and precipitation type. Due to historic snowfall amounts, during the February 24, 2023 snow event, the weather station became buried. Data from the nearby TERC2 weather station are substituted for the time period after burial until the weather station melted out May 3, 2023. Events highlighted in green were sampled for water quality. Because of its high elevation, precipitation often falls in the form of snow during fall/winter and spring and thus does not always generate sufficient runoff for sampling. In general, events consisting of less than 0.5 inches of rain do not produce sufficient runoff for sampling. However, some events less than 0.5 inches can be successfully sampled.

Table 2 Summary of fall/winter, spring, and summer precipitation events at SR431 for WY23. Highlighted rows indicate events that were sampled.

Station ID	Precip Event (#)	Precipitation event start (PST)	Event end (PST)	Event duration (days)	Interevent duration (days)	Event precipitation (inches)	Event peak precipitation (inch/5min)	Event minimum temp (°C)	Event maximum temp (°C)	Type of Precipitation
NDOT	--	--	9/21/2022 11:10	--	--	--	--	--	--	--
NDOT	NDOT-23-01	10/22/2022 6:25	10/22/2022 15:30	0.378	30.8	0.1400	0.016	-2	8	Rain, Snow
NDOT	NDOT-23-02	11/1/2022 14:05	11/2/2022 18:20	1.177	9.9	0.4030	0.019	-6	-1	Snow
NDOT	NDOT-23-03	11/6/2022 0:00	11/9/2022 8:35	3.358	3.2	0.8220	0.019	-8	5	Rain, Snow
NDOT	NDOT-23-04	11/12/2022 15:00	11/12/2022 21:50	0.285	3.3	0.1080	0.008	-5	-2	Snow
NDOT	NDOT-23-05	11/26/2022 7:25	11/26/2022 7:35	0.007	13.4	0.0120	0.008	-2	-1	Spurious
NDOT	NDOT-23-06	12/1/2022 6:00	12/6/2022 3:30	4.896	4.9	2.1230	0.019	-14	4	Rain/Snow
NDOT	NDOT-23-07	12/8/2022 20:50	12/9/2022 1:45	0.205	2.7	0.0720	0.004	-5	-4	Snow
NDOT	NDOT-23-08	12/10/2022 6:05	12/12/2022 13:35	2.313	1.2	1.2620	0.047	-13	-1	Rain, Snow
NDOT	NDOT-23-09	12/26/2022 23:35	12/27/2022 22:05	0.938	14.4	2.0540	0.031	-4	2	Rain/Snow
NDOT	NDOT-23-10	12/28/2022 8:35	1/2/2023 21:25	5.535	0.4	4.3100	0.023	-13	3	Rain/Snow
NDOT	NDOT-23-11	1/4/2023 9:00	1/5/2023 22:50	1.576	1.5	0.8680	0.016	-4	4	Rain/Snow
NDOT	NDOT-23-12	1/7/2023 17:40	1/11/2023 23:35	4.247	1.8	3.3960	0.027	-6	0	Rain/Snow
NDOT	NDOT-23-13	1/13/2023 12:45	1/16/2023 21:45	3.375	1.5	2.0160	0.027	-8	3	Snow
NDOT	NDOT-23-14	1/18/2023 19:55	1/21/2023 13:20	2.726	1.9	1.4750	0.105	-14	6	Snow
NDOT	NDOT-23-15	1/29/2023 10:20	1/29/2023 10:20	0.000	7.9	0.0040	0.004	-7	-7	Snow
NDOT	NDOT-23-16	1/30/2023 20:35	1/30/2023 20:35	0.000	1.4	0.0040	0.004	-9	-9	Snow
NDOT	NDOT-23-17	2/5/2023 4:35	2/7/2023 19:30	2.622	5.3	0.0440	0.004	-12	7	Snow
NDOT	NDOT-23-18	2/12/2023 3:50	2/12/2023 3:50	0.000	4.3	0.0040	0.004	-3	-3	Snow
TERC2	NDOT-23-19	2/24/2023 11:15	3/1/2023 12:25	5.049	12.3	1.3440	0.012	-11	2	Snow
TERC2	NDOT-23-20	3/4/2023 12:40	3/5/2023 19:45	1.295	3.0	0.4320	0.016	-5	-2	Snow
TERC2	NDOT-23-21	3/7/2023 1:55	3/7/2023 6:20	0.184	1.3	0.0640	0.008	-3	-3	Snow
TERC2	NDOT-23-22	3/8/2023 7:35	3/8/2023 13:40	0.253	1.1	0.0960	0.016	-3	-2	Snow
TERC2	NDOT-23-23	3/9/2023 15:10	3/14/2023 21:20	5.257	1.1	4.0820	0.035	-2	-1	Rain/Snow
TERC2	NDOT-23-24	3/19/2023 9:25	3/20/2023 0:45	0.639	4.5	0.2640	0.012	-1	-1	Snow
TERC2	NDOT-23-25	3/21/2023 10:05	3/22/2023 1:25	0.639	1.4	0.0520	0.008	-1	-1	Snow
TERC2	NDOT-23-26	3/23/2023 6:45	3/23/2023 7:25	0.028	1.2	0.0240	0.008	-1	-1	Snow
TERC2	NDOT-23-27	3/28/2023 9:50	3/29/2023 19:40	1.410	5.1	0.4680	0.012	-1	-1	Snow
TERC2	NDOT-23-28	4/2/2023 22:30	4/3/2023 10:35	0.503	4.1	0.0680	0.012	-3	-2	Snow
TERC2	NDOT-23-29	4/7/2023 5:20	4/7/2023 11:15	0.247	3.8	0.1120	0.008	-3	0	Rain/Snow
TERC2	NDOT-23-30	4/18/2023 0:45	4/18/2023 9:35	0.368	10.6	0.1520	0.008	-9	-4	Snow
NDOT	NDOT-23-31	4/22/2023 11:40	4/22/2023 11:40	0.000	4.1	0.0040	0.004	9	9	Snow
NDOT	NDOT-23-32	5/1/2023 20:45	5/3/2023 4:00	1.302	9.4	0.7650	0.027	-4	1	Snow
NDOT	NDOT-23-33	5/4/2023 11:45	5/6/2023 21:05	2.389	1.3	0.6970	0.023	-3	4	Snow
NDOT	NDOT-23-34	5/14/2023 12:55	5/14/2023 17:05	0.174	7.7	0.0240	0.004	7	13	Thunderstorm
NDOT	NDOT-23-35	5/24/2023 14:30	5/26/2023 16:50	2.097	9.9	0.4190	0.074	2	14	Thunderstorm
NDOT	NDOT-23-36	5/29/2023 19:35	5/29/2023 20:05	0.021	3.1	0.0120	0.004	7	8	Thunderstorm
NDOT	NDOT-23-37	5/31/2023 14:30	6/1/2023 7:00	0.688	1.8	0.1910	0.039	2	15	Thunderstorm
NDOT	NDOT-23-38	6/6/2023 2:05	6/7/2023 2:15	1.007	4.8	0.0520	0.012	5	18	Thunderstorm
NDOT	NDOT-23-39	6/8/2023 11:15	6/8/2023 12:10	0.038	1.4	0.0680	0.016	6	11	Thunderstorm
NDOT	NDOT-23-40	6/10/2023 13:35	6/10/2023 17:30	0.163	2.1	0.4050	0.058	6	12	Thunderstorm
NDOT	NDOT-23-41	6/11/2023 17:45	6/13/2023 21:10	2.142	1.0	0.9670	0.035	3	17	Thunderstorm
NDOT	NDOT-23-42	6/22/2023 16:55	6/22/2023 20:35	0.153	8.8	0.5730	0.070	2	10	Thunderstorm
NDOT	NDOT-23-43	6/27/2023 13:40	6/28/2023 15:40	1.083	4.7	0.0790	0.019	6	19	Thunderstorm
NDOT	NDOT-23-44	8/12/2023 16:45	8/12/2023 19:55	0.132	45.0	0.0280	0.012	17	24	Thunderstorm
NDOT	NDOT-23-45	8/14/2023 13:55	8/14/2023 19:00	0.212	1.8	0.1070	0.027	12	21	Thunderstorm
NDOT	NDOT-23-46	8/16/2023 16:05	8/17/2023 3:20	0.469	1.9	0.1150	0.031	13	20	Thunderstorm
NDOT	NDOT-23-47	8/18/2023 18:55	8/18/2023 22:00	0.128	1.6	0.1300	0.047	10	16	Thunderstorm
NDOT	NDOT-23-48	8/19/2023 15:10	8/20/2023 7:40	0.688	0.7	0.2260	0.019	8	19	Thunderstorm
NDOT	NDOT-23-49	8/20/2023 20:20	8/21/2023 7:50	0.479	0.5	0.6000	0.016	8	11	Thunderstorm
NDOT	NDOT-23-50	8/21/2023 18:20	8/22/2023 8:50	0.604	0.4	0.5480	0.101	6	10	Rain
NDOT	NDOT-23-51	8/24/2023 19:50	8/24/2023 19:55	0.003	2.5	0.0240	0.016	13	15	Thunderstorm
NDOT	NDOT-23-52	9/1/2023 11:15	9/1/2023 22:20	0.462	7.6	0.4210	0.027	6	10	Thunderstorm
NDOT	NDOT-23-53	9/2/2023 12:30	9/3/2023 15:30	1.125	0.6	0.1970	0.031	7	11	Thunderstorm

6. Provide hydrograph, continuous turbidity, and sample distribution graphs for each sampled event

See Appendix A, Figure 11 - Figure 22 at the end of this report for hydrographs, continuous turbidity, and sample distributions for the events sampled in the summer season of WY23.

Task 3: Condition Assessments

1. Estimate Road RAM score prior to monitored runoff events

This task was initiated in November 2015 following a meeting between Tahoe RCD and NDOT where it was decided that determining a Road RAM score prior to runoff events was valuable. However, after five and a half years of collecting this data, it was clear that there is no relationship between Road RAM score and event mean sediment concentration at the SR431 site and this task was discontinued beginning June 1, 2021 (summer season of water year 2021).

2. Measure depth of sediment in vaults after eight monitored runoff events

This task was initiated November 2015 following the meeting between Tahoe RCD and NDOT mentioned above where it was determined that post event sediment depth was valuable information. The depths shown in Table 3 represent the average depth in each vault in feet. All clean-outs restored sediment depth in the respective vaults to near zero. Summer and fall of WY18 were dry and minimal sediment accumulation occurred by January of 2019 (~0.1 feet for both the Contech MFS and the Jellyfish). No sediment accumulation measurements were conducted during the lapse of funding that occurred July 2018-December 2018. February 2019 was the snowiest month on record for many areas in the Tahoe basin, and therefore it was not possible to conduct sediment accumulation until May 2019 due to lack of access to the vaults. By May 2019 substantial sediment had entered the system and a cleanout was performed in June 2019, restoring the sediment depth to zero. A small amount of sediment accumulation occurred by the end of summer WY19 due to a series of thunderstorms in September. Little to no sediment accumulation occurred during the fall/winter of WY20. Some sediment accumulation was observed during the spring of WY20. Both vaults were vactored on May 12, 2020. Little to no sediment accumulation was observed at the Contech vault over the summer of WY20, possibly due to the fact that sediment accumulation in the splitter chamber was preferentially routing flow to the Jellyfish. The Jellyfish vault saw 0.13 feet of summertime sediment accumulation (from 0.11 feet in June 2020 to 0.24 feet in September 2020). Little to no sediment accumulation occurred during the fall/winter of WY21 in either vault. Both the Contech and the Jellyfish vaults were vactored on March 8, 2021. A small amount of sediment accumulation occurred during the spring of WY21. The pipes from the splitter vault to the outflows were cleaned with a pressure washer by Tahoe RCD on May 11, 2021. Minimal sediment accumulation occurred over the summer of WY21. The system was fully vactored and rinsed on October 21, 2021, and the filters to both the Contech MFS and the Jellyfish were replaced. There was minimal sediment accumulation during the fall/winter and spring of WY22. In the summer of WY22 there was minimal sediment accumulation in the Jellyfish vault and some accumulation in the Contech vault. On November 17, 2022 NDOT rinsed the Contech MFS filters and vactored the hydrodynamic separator, the splitter vault, splitter to inflow pipes, and Contech MFS vault. In the record-breaking fall/winter and spring of WY23, manhole access to the vaults was inaccessible, so sediment depth was not recorded after the sampled events in the spring season. Vaults were accessible on June 4, 2023, so a sediment depth was taken in both vaults then. During the summer of WY23, construction activities made manhole access challenging, but sediment depth was taken on June 21, 2023.

Table 3 Average depth of sediment in vaults.

Date Time	Contech MFS (ft)	Jellyfish (ft)
12/30/2015	0.33	0.92
3/16/2016	0.58	1.14
4/15/2016	0.61	na
4/22/2016	0.56	na
6/3/2016	0.75	2.17
8/3/2016	1.10	2.05
10/20/2016	na	1.92
12/30/2016	0.10	0.05
4/3/2016	1.00	2.30
4/20/2017	1.90	2.85
5/1/2017	0.10	0.43
5/18/2017	0.08	0.37
5/22/2017	0.10	0.46
6/19/2017	0.12	0.38
8/19/2017	0.00	0.00
9/21/2017	0.01	0.10
10/5/2017	0.03	0.15
10/24/2017	0.00	0.04
11/14/2017	0.10	1.19
11/17/2017	0.00	0.10
2/2/2018	0.17	0.30
4/7/2018	0.00	0.05
5/17/2018	0.08	0.36

Table 3 Continued.

Date Time	Contech MFS (ft)	Jellyfish (ft)
1/2/2019	0.10	0.09
5/8/2019	0.25	0.38
6/25/2019	0.00	0.00
10/21/2019	0.10	0.09
2/26/2020	0.10	0.12
4/22/2020	0.19	0.38
6/17/2020	0.10	0.11
8/7/2020	0.10	0.13
9/3/2020	0.10	0.24
11/4/2020	0.08	0.22
2/16/2021	0.06	0.22
3/22/2021	0.06	0.09
5/11/2021	0.10	0.11
6/9/2021	0.10	0.03
10/13/2021	0.06	0.09
10/26/2021	0.06	0.09
1/27/2022	0.00	0.09
3/30/2022	0.06	0.07
4/22/2022	0.06	0.09
5/18/2022	0.06	0.09
9/29/2022	0.15	0.09
10/25/2022	0.10	0.09
6/4/2023	0.10	0.00
6/21/2023	0.08	0.09

Task 4: Final Report

1. Provide raw data

Final reporting for each water year is provided as part of the Annual Stormwater Monitoring Report (due March 31st of each year), but raw data can be viewed at any time on Acuity.

2. Provide treatment effectiveness analysis following formats outlined in the RSWMP FIG

Final reporting for each water year is provided as part of the Annual Stormwater Monitoring Report (due March 31st of each year) which includes treatment effectiveness evaluations for FSP, TN, and TP on a seasonal and annual basis as well as for sampled events. The data for FSP in the Annual Stormwater Monitoring Report is based on water quality samples and continuous turbidity. However, treatment effectiveness for FSP for WY23 is provided for all events for the Contech MFS in Table 4 and the Jellyfish in Table 5 based on continuous turbidity, a proxy measurement for FSP (2NDNATURE et al 2014). Removal efficiencies in red indicate that FSP was flushed from the system or that outflow turbidity sensors were inundated with accumulated sediment. A removal efficiency of 100% indicates no outflow from the Contech MFS vault, which occurs when influent volumes are less than 3,000 cubic feet (the approximate storage capacity of the Contech MFS vault) and the vault can accommodate the new flow. Sometimes the vault is full from a previous event and even small inflow volumes will result in outflow. The holding capacity of the Contech MFS is likely what allows it to generally be more efficient than the Jellyfish; not only because it often doesn't outflow, but also because sediment has the opportunity to settle out during the longer residence time in the vault.

During the fall/winter season of WY23, for both the Contech MFS and the Jellyfish in general, FSP removal efficiency steadily declined from October 2023 through December 2023, from 97% to 29% in the Contech MFS and from 90% to 17% in the Jellyfish. The large runoff events occurred in this period and there was likely a significant build up of sediment in the system that contributed to the decline. There was no flow recorded at either site during January. In February there were several periods of very low flow snowmelt. At the Contech MFS removal efficiencies were 100% because 100% of the flow was retained in the vault. Likewise, removal efficiencies

in the Jellyfish were between 95% and 99% in February because of very low flows and half or more of the flow being retained in the vault.

During the spring season of WY23, the Contech generally showed higher turbidity at the outflow than the inflow (red negative efficiencies in Table 4). However, many of these events were very small, with volumes under 100 cf, and therefore the overall excretion of sediment is not large. It is also possible that accumulated sediment near the turbidimeter is causing it to read higher values than can actually be attributed to the effluent. This vault needs to be maintained. By the end of May, there is some sediment reduction efficiency shown again, so it is possible that the larger event in the beginning of May flushed out any accumulated sediment in the area near the turbidimeter and it started reading accurately again. The Jellyfish showed removal efficiencies between 22% and 95%, with some very small events showing 100% removal efficiency because there was no outflow. Smaller events tend to have higher removal efficiencies and larger events tend to have lower removal efficiencies (Table 5).

Removal efficiencies for the Contech during the summer of WY23 were generally high for all events (63%-100% with two events less than 30%). Efficiencies dropped a bit in August, likely because the system needs maintenance. The negative efficiency for the thunderstorm from August 20-21, 2023 may have been a sensor error due to sediment accumulation. Removal efficiencies in the Jellyfish during the summer of WY23 were also generally high (51%-100%).

Table 4 Contech MFS FSP removal efficiency for each event of fall/winter, spring, and summer WY23.

CONTECH MFS WY23									
Runoff Start Date Time	Runoff End Date Time	Runoff Type	Event Duration	Influent Volume (cf)	Effluent Volume (cf)	Influent FSP (lbs)	Effluent FSP (lbs)	FSP Removal Efficiency	Volume Retained
10/22/22 15:15	10/22/22 15:50	Rain, Snow	0:35	34	10	0.140	0.017	88%	70%
11/2/22 12:40	11/2/22 13:25	Event Snowmelt	0:45	27	5	0.248	0.007	97%	80%
12/3/22 14:40	12/3/22 20:00	Rain on Snow	5:20	298	147	2.808	1.273	55%	51%
12/3/22 23:35	12/4/22 0:00	Rain on Snow	0:25	3	0	0.015	0.000	100%	100%
12/27/22 1:10	12/27/22 9:45	Rain on Snow	8:35	1,485	1,143	27.351	15.949	42%	23%
12/30/22 5:05	12/31/22 3:55	Rain on Snow	22:50	5,047	3,972	32.900	23.291	29%	21%
2/9/23 15:45	2/9/23 17:30	Non-event Snowmelt	1:45	12	0	0.085	0.000	100%	100%
2/10/23 16:05	2/10/23 16:45	Non-event Snowmelt	0:40	3	0	0.019	0.000	100%	100%
2/11/23 10:55	2/11/23 11:45	Non-event Snowmelt	0:50	15	1	0.073	0.012	84%	94%
2/13/23 14:50	2/13/23 16:10	Non-event Snowmelt	1:20	15	0	0.032	0.000	100%	100%
2/25/23 13:05	2/25/23 14:25	Event Snowmelt	1:20	7	0	0.021	0.000	100%	100%
3/2/23 12:35	3/2/23 15:25	Event Snowmelt	2:50	233	155	2.475	7.943	-221%	33%
3/7/23 12:50	3/7/23 14:15	Event Snowmelt	1:25	55	24	0.502	0.514	-2%	56%
3/10/23 6:25	3/10/23 10:10	Rain on Snow	3:45	235	157	1.025	3.292	-221%	33%
3/10/23 11:55	3/10/23 16:40	Rain on Snow	4:45	208	126	1.202	2.783	-132%	39%
3/13/23 11:45	3/14/23 18:05	Rain on Snow	30:20	418	248	2.502	5.532	-121%	41%
3/15/23 10:00	3/15/23 17:35	Non-event Snowmelt	7:35	169	95	0.957	1.978	-107%	44%
3/16/23 9:50	3/16/23 17:35	Non-event Snowmelt	7:45	84	24	0.283	0.668	-136%	71%
3/17/23 13:35	3/17/23 16:20	Non-event Snowmelt	2:45	52	21	0.158	0.571	-262%	60%
3/19/23 11:35	3/19/23 16:20	Non-event Snowmelt	4:45	91	42	0.199	1.026	-416%	54%
3/20/23 10:00	3/20/23 12:25	Event Snowmelt	2:25	88	48	0.210	1.134	-440%	45%
3/22/23 12:50	3/22/23 13:55	Event Snowmelt	1:05	5	0	0.005	0.000	100%	100%
3/23/23 9:55	3/23/23 11:50	Non-event Snowmelt	1:55	19	6	0.018	0.080	-349%	70%
3/29/23 14:35	3/29/23 16:40	Event Snowmelt	2:05	149	103	0.131	1.867	-1322%	31%
3/30/23 10:10	3/30/23 11:30	Non-event Snowmelt	1:20	18	4	0.004	0.075	-1858%	75%
4/3/23 11:25	4/3/23 12:10	Non-event Snowmelt	0:45	26	10	0.005	0.094	-1976%	59%
4/5/23 16:55	4/5/23 18:20	Non-event Snowmelt	1:25	12	1	0.002	0.012	-483%	93%
4/6/23 14:25	4/6/23 20:05	Non-event Snowmelt	5:40	112	62	0.010	0.632	-6247%	45%
4/7/23 10:10	4/7/23 13:10	Rain on Snow	3:00	109	60	0.012	0.713	-6053%	45%
4/8/23 14:35	4/8/23 17:35	Non-event Snowmelt	3:00	51	25	0.002	0.249	-10934%	50%
4/9/23 13:30	4/9/23 21:20	Non-event Snowmelt	7:50	841	652	0.131	7.880	-5923%	22%
4/10/23 13:00	4/11/23 20:45	Non-event Snowmelt	31:45	1,790	1,399	0.378	15.199	-3917%	22%
4/12/23 13:05	4/12/23 19:30	Non-event Snowmelt	6:25	300	199	0.020	1.206	-5901%	33%
5/1/23 21:05	5/6/23 11:00	Rain on Snow	109:55	1,191	806	1.506	3.096	-106%	32%
5/24/23 15:20	5/24/23 17:10	Thunderstorm	1:50	231	163	0.380	0.470	-24%	29%
5/26/23 16:20	5/26/23 17:20	Thunderstorm	1:00	346	276	3.854	1.439	63%	20%
5/31/23 14:40	5/31/23 15:45	Thunderstorm	1:05	214	149	1.866	0.314	83%	30%
6/6/23 3:45	6/6/23 4:20	Thunderstorm	0:35	16	1	0.024	0.001	97%	93%
6/8/23 11:55	6/8/23 12:30	Thunderstorm	0:35	10	0	0.013	0.000	100%	100%
6/10/23 13:55	6/10/23 16:55	Thunderstorm	3:00	829	652	3.659	0.932	75%	21%
6/11/23 17:45	6/11/23 21:55	Thunderstorm	4:10	1,364	1,101	2.360	0.868	63%	19%
6/12/23 9:30	6/12/23 17:30	Thunderstorm	8:00	319	200	0.735	0.224	69%	37%
6/13/23 16:25	6/13/23 17:10	Thunderstorm	0:45	12	0	0.011	0.000	100%	100%
6/22/23 16:55	6/22/23 19:10	Thunderstorm	2:15	964	843	5.003	0.970	81%	13%
6/28/23 12:45	6/28/23 13:20	Thunderstorm	0:35	18	1	0.021	0.000	99%	97%
8/14/23 17:05	8/14/23 20:00	Thunderstorm	2:55	77	0	0.869	0.000	100%	100%
8/16/23 19:00	8/16/23 19:45	Thunderstorm	0:45	58	20	0.326	0.018	95%	66%
8/18/23 19:00	8/18/23 23:10	Thunderstorm	4:10	196	94	1.075	0.164	85%	52%
8/19/23 15:20	8/20/23 4:10	Thunderstorm	12:50	307	106	0.097	0.069	29%	65%
8/20/23 20:55	8/21/23 7:05	Thunderstorm	10:10	1,372	858	0.710	0.851	-20%	37%
8/22/23 1:55	8/22/23 9:35	Rain	7:40	1,163	843	4.180	1.080	74%	28%
8/24/23 20:00	8/24/23 20:40	Thunderstorm	0:40	16	0	0.020	0.000	100%	100%
9/1/23 15:55	9/1/23 23:25	Thunderstorm	7:30	761	403	0.852	0.635	25%	47%
9/2/23 13:00	9/3/23 9:50	Thunderstorm	20:50	0	105	0.000	0.144	na	na

Table 5 Jellyfish FSP removal efficiency for each event of fall/winter WY23.

JELLYFISH WY23									
Runoff Start Date Time	Runoff End Date Time	Runoff Type	Event Duration	Influent Volume (cf)	Effluent Volume (cf)	Influent FSP (lbs)	Effluent FSP (lbs)	Removal Efficiency	Volume Retained
10/22/22 15:15	10/22/22 16:10	Rain, Snow	0:55	54	25	0.198	0.021	90%	54%
11/2/22 12:40	11/2/22 14:20	Event Snowmelt	1:40	57	21	0.342	0.033	90%	63%
12/3/22 14:35	12/3/22 20:10	Rain on Snow	5:35	298	173	2.026	1.304	36%	42%
12/3/22 22:50	12/4/22 1:50	Rain on Snow	3:00	43	10	0.147	0.034	77%	78%
12/27/22 0:30	12/27/22 12:45	Rain on Snow	12:15	1,742	1,637	22.54	16.61	26%	6%
12/30/22 4:15	12/31/22 5:15	Rain on Snow	25:00	5,512	4,819	25.93	21.42	17%	13%
2/9/23 13:25	2/9/23 17:55	Non-event Snowmelt	4:30	38	25	1.065	0.074	93%	34%
2/10/23 14:55	2/10/23 17:25	Non-event Snowmelt	2:30	21	8	0.568	0.018	97%	62%
2/11/23 10:55	2/11/23 15:35	Non-event Snowmelt	4:40	54	27	1.134	0.030	97%	50%
2/12/23 13:50	2/12/23 17:20	Non-event Snowmelt	3:30	32	8	0.451	0.010	98%	75%
2/13/23 11:45	2/13/23 16:30	Non-event Snowmelt	4:45	59	39	0.881	0.038	96%	34%
2/25/23 13:00	2/25/23 14:50	Event Snowmelt	1:50	19	13	0.535	0.006	99%	30%
3/2/23 12:35	3/2/23 16:00	Event Snowmelt	3:25	280	253	9.232	1.936	79%	10%
3/7/23 12:50	3/7/23 14:45	Event Snowmelt	1:55	78	66	2.067	0.094	95%	15%
3/9/23 11:35	3/10/23 10:50	Rain on Snow	23:15	8	271	0.053	0.688	100%	100%
3/10/23 6:15	3/10/23 17:15	Rain on Snow	11:00	283	262	3.683	0.884	81%	4%
3/10/23 11:40	3/14/23 19:45	Rain on Snow	104:05	273	496	3.748	1.380	76%	4%
3/13/23 11:45	3/15/23 18:05	Rain on Snow	54:20	584	175	7.222	0.352	81%	15%
3/15/23 10:00	3/16/23 18:05	Non-event Snowmelt	32:05	180	80	1.999	0.114	82%	3%
3/16/23 9:50	3/17/23 17:00	Non-event Snowmelt	31:10	91	52	0.843	0.054	87%	13%
3/17/23 10:10	3/19/23 16:20	Non-event Snowmelt	54:10	66	85	0.604	0.075	91%	21%
3/18/23 13:40	3/20/23 12:45	Non-event Snowmelt	47:05	1	75	0.005	0.053	100%	100%
3/19/23 11:35	3/22/23 14:30	Non-event Snowmelt	74:55	100	23	0.757	0.006	90%	15%
3/20/23 10:00	3/23/23 11:55	Event Snowmelt	73:55	88	21	0.504	0.005	89%	14%
3/22/23 12:15	3/29/23 16:50	Event Snowmelt	172:35	24	165	0.065	0.064	90%	4%
3/23/23 9:55	3/30/23 12:35	Non-event Snowmelt	170:40	23	28	0.072	0.007	93%	10%
3/24/23 11:25	3/31/23 14:15	Non-event Snowmelt	170:50	7	10	0.006	0.001	100%	100%
3/29/23 14:30	4/1/23 17:10	Event Snowmelt	74:40	174	2	0.430	0.000	85%	5%
3/30/23 10:00	4/2/23 10:45	Non-event Snowmelt	72:45	37	4	0.024	0.001	71%	25%
3/31/23 12:10	4/3/23 12:25	Non-event Snowmelt	72:15	12	28	0.014	0.003	90%	15%
4/1/23 16:05	4/5/23 18:50	Event Snowmelt	98:45	5	19	0.006	0.003	93%	53%
4/2/23 9:50	4/6/23 20:45	Non-event Snowmelt	106:55	11	110	0.004	0.014	87%	68%
4/3/23 11:25	4/7/23 14:10	Non-event Snowmelt	98:45	39	140	0.038	0.019	92%	27%
4/5/23 16:50	4/8/23 17:45	Non-event Snowmelt	72:55	24	74	0.014	0.008	80%	20%
4/6/23 10:00	4/9/23 22:35	Non-event Snowmelt	84:35	121	873	0.058	0.151	76%	9%
4/7/23 10:10	4/11/23 21:50	Rain on Snow	107:40	145	1,948	0.084	0.311	78%	4%
4/8/23 11:30	4/12/23 20:05	Non-event Snowmelt	104:35	76	383	0.021	0.038	63%	2%
4/9/23 12:05	4/18/23 10:35	Non-event Snowmelt	214:30	931	5	0.336	0.001	55%	6%
4/10/23 9:05	5/6/23 11:15	Non-event Snowmelt	626:10	1,985	1,408	0.685	0.088	55%	2%
4/12/23 12:40	5/24/23 17:00	Non-event Snowmelt	1012:20	428	229	0.051	0.010	26%	10%
4/18/23 9:55	5/26/23 17:20	Event Snowmelt	919:25	8	334	0.001	0.258	22%	37%
5/1/23 21:05	5/31/23 15:30	Rain on Snow	714:25	1,452	194	0.259	0.081	66%	3%
5/24/23 15:20	6/6/23 4:25	Thunderstorm	301:05	248	8	0.054	0.001	82%	8%
5/26/23 16:20	6/8/23 12:30	Thunderstorm	308:10	359	3	1.298	0.000	80%	7%
5/31/23 14:40	6/10/23 16:50	Thunderstorm	242:10	216	777	0.970	0.189	92%	10%
6/6/23 3:45	6/11/23 21:55	Thunderstorm	138:10	24	1,270	0.042	0.151	98%	67%
6/8/23 11:50	6/12/23 17:15	Thunderstorm	101:25	21	259	0.026	0.067	98%	85%
6/10/23 13:50	6/13/23 17:00	Thunderstorm	75:10	923	2	2.203	0.000	91%	16%
6/11/23 17:45	6/22/23 19:00	Thunderstorm	265:15	1,521	929	1.455	0.282	90%	16%
6/12/23 9:30	6/28/23 13:15	Thunderstorm	387:45	446	7	0.680	0.000	90%	42%
6/13/23 16:25	6/13/23 17:10	Thunderstorm	0:45	23	0	0.022	0.000	99%	90%
6/22/23 16:55	6/22/23 19:10	Thunderstorm	2:15	1,080	0	7.662	0.000	96%	14%
6/28/23 12:45	8/18/23 22:45	Thunderstorm	1234:00	44	92	0.046	0.019	99%	84%
8/14/23 17:05	8/20/23 3:55	Thunderstorm	130:50	342	170	0.504	0.011	100%	100%
8/16/23 19:00	8/21/23 7:05	Thunderstorm	108:05	27	1,052	0.041	0.107	100%	100%
8/18/23 19:00	8/22/23 9:05	Thunderstorm	86:05	105	1,002	0.159	0.173	88%	12%
8/19/23 15:20	8/24/23 20:25	Thunderstorm	125:05	214	1	0.028	0.000	61%	20%
8/20/23 21:00	9/1/23 23:05	Thunderstorm	290:05	1,115	511	0.218	0.044	51%	6%
8/22/23 1:55	9/3/23 11:10	Rain	297:15	1,050	143	0.404	0.012	57%	5%
8/24/23 20:00	8/24/23 20:30	Thunderstorm	0:30	9	0	0.002	0.000	98%	94%
9/1/23 15:55	9/1/23 22:45	Thunderstorm	6:50	632	0	0.106	0.000	59%	19%
9/2/23 12:55	9/3/23 9:35	Thunderstorm	20:40	204	0	0.030	0.000	61%	30%

In accordance with the RSWMP FIG section 2.1, monitoring for trends at urban catchment outfalls is important because it provides information needed for evaluating progress toward TMDL and other regulatory goals. The objective of the trends monitoring is to detect and report the cumulative load reduction benefits of all actions implemented within the catchment over long time frames and ultimately demonstrate a local and regional reduction in pollutant loading to the lake. This statement holds true for the inflow sites at SR431. For the outflow sites at SR431, trend analysis will give insight into the effectiveness of maintenance activities in sustaining FSP removal efficiencies of the treatment vaults.

Average annual loads for FSP, TN, and TP presented in this section are normalized by both catchment size (acres) and inches of precipitation to detect load reductions resulting from improved management activities within the catchment and for comparison between water years. Percent runoff (runoff coefficient) is a function of catchment size, the amount of rainfall received, and the volume measured at the catchment outfall. It represents the fraction of runoff that was measured at the outfall compared to what would theoretically be expected if all the rainfall that fell in the catchment were measured at the outfall as runoff.

Normalized average annual load charts for the SR431 catchment show whether there is an upward, downward, or neutral trend in average annual loading of FSP, TN, and TP at each site. Also presented is a table that shows average annual percent runoff and normalized seasonal and average annual loads and trend statistics. The trend statistics (Tau, p-value, and Theil slope) indicate if there has been a statistically significant upward, downward, or neutral trend in pollutant loading in the catchment. Tau is a non-parametric measure of the relationship between data when data does not have a normal distribution, similar to the r^2 value in a regression on normally distributed data. Tau is a measure of the correspondence between two rankings, in this case are water year and pollutant load. Tau is a correlation coefficient that returns a value between -1 and 1 where 0 is no relationship, 1 is a perfect identical relationship and -1 is a perfect opposite relationship with regards to ranked pairs. The water years will always be ranked in order from 2014 through 2022. The pollutant loads are then ranked from least to most as well. The rankings of the pairs are then compared. If pollutant load steadily increases from year to year there will be a perfect identical ranking between the pairs, resulting in a Tau of 1. If pollutant load steadily decreases from year to year there will a perfect opposite ranking of the pairs, resulting in a Tau of -1. The p-value indicates the confidence level in Tau; a p-value less than 0.05 ($p < 0.05$) denotes a significant relationship. The Theil slope is similar to the slope for a regression on normalized data, but used for data that is not normally distributed. Lastly, charts showing annual sediment and nutrient loads and annual precipitation totals for each site are included to help visualize how precipitation and loads have varied over the period of record for each site. Trends data is updated annually with the Annual Stormwater Monitoring Report, so data shown here is only through the end of WY22.

Trends data for the Contech MFS inflow is shown in Figure 7 and Table 6. Trends data for the Contech MFS outflow is shown in Figure 8 and Table 7. Trends data for the Jellyfish inflow is shown in Figure 9 and Table 8. Trends data for the Jellyfish outflow is shown in Figure 10 and Table 9.

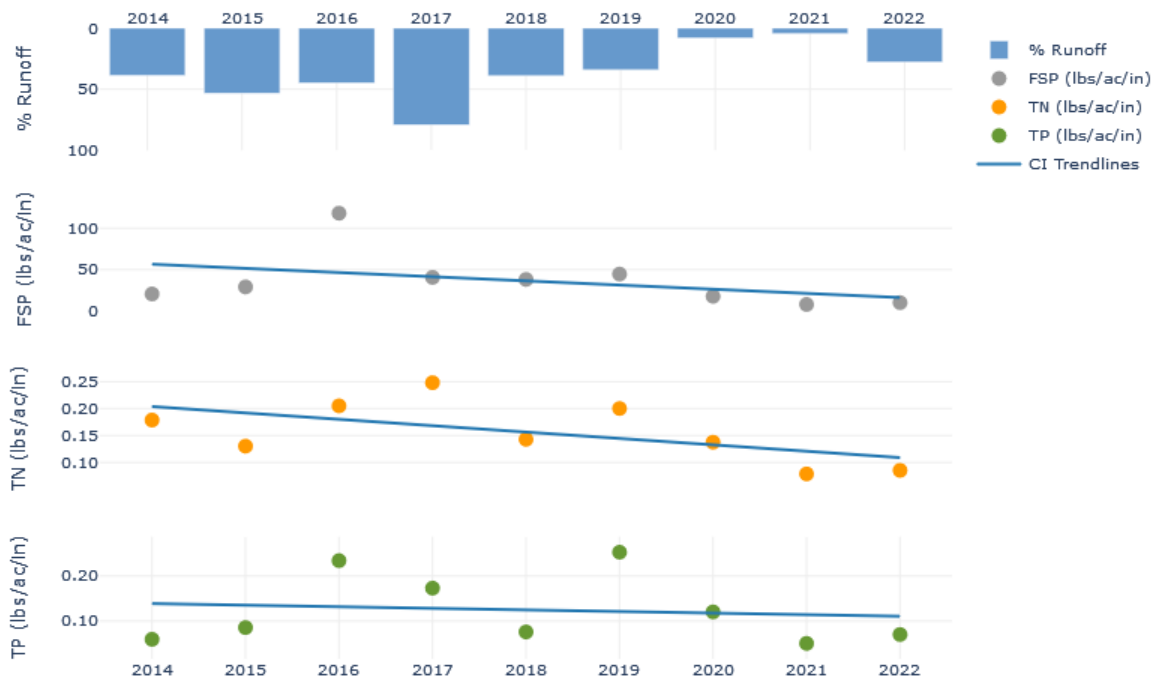


Figure 7 9-year rainfall normalized annual pollutant load trends in FSP, TN, and TP loads at the Contech MFS Inflow, WY14-22.

- Percent runoff varied between 4.4% in WY21 to 78.9% in WY17. Differences in % runoff between CI and JI are attributed to sediment accumulation in the splitter chamber that caused an unequal division of runoff to each vault.
- There is no significant trend in normalized annual FSP loads ($p > 0.05$).
- There is no significant trend in normalized annual TN loads ($p > 0.05$).
- There is no significant trend in normalized annual TP loads ($p > 0.05$).

Table 6 9-year seasonal and annual rainfall normalized pollutant loads at the Contech MFS Inflow, WY14-22.

Year	% Runoff	FSP (lbs/acre/Inch)				TN (lbs/acre/Inch)				TP (lbs/acre/Inch)			
		Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual
2014	38.6%	8.358	43.467	23.094	20.612	0.065	0.230	0.386	0.179	0.021	0.122	0.079	0.060
2015	53.2%	29.875	41.461	7.517	29.122	0.127	0.164	0.086	0.130	0.097	0.110	0.015	0.086
2016	44.7%	84.812	183.564	0.000	118.153	0.179	0.260	0.000	0.205	0.149	0.399	0.000	0.234
2017	78.9%	19.239	139.993	20.235	40.646	0.178	0.611	0.048	0.248	0.064	0.688	0.035	0.173
2018	39.0%	23.391	51.881	20.808	38.173	0.136	0.116	0.554	0.143	0.083	0.068	0.113	0.076
2019	34.2%	11.578	153.825	8.569	44.624	0.083	0.565	0.227	0.200	0.066	0.866	0.070	0.253
2020	8.0%	9.896	26.907	39.794	17.783	0.040	0.148	0.723	0.138	0.068	0.175	0.288	0.120
2021	4.4%	2.493	22.475	23.756	8.003	0.010	0.130	0.671	0.079	0.016	0.132	0.185	0.051
2022	27.7%	3.207	44.045	10.423	10.133	0.050	0.191	0.183	0.085	0.030	0.267	0.076	0.070
Tau	na	-0.500	-0.222	0.222	-0.333	-0.444	-0.167	0.278	-0.389	-0.278	0.167	0.389	-0.111
P-Value	na	0.061	0.404	0.404	0.211	0.095	0.532	0.297	0.144	0.297	0.532	0.144	0.677
Theil Slope (per year)	na	-3.820	-2.955	0.595	-3.116	-0.018	-0.009	0.040	-0.013	-0.008	0.011	0.014	-0.002

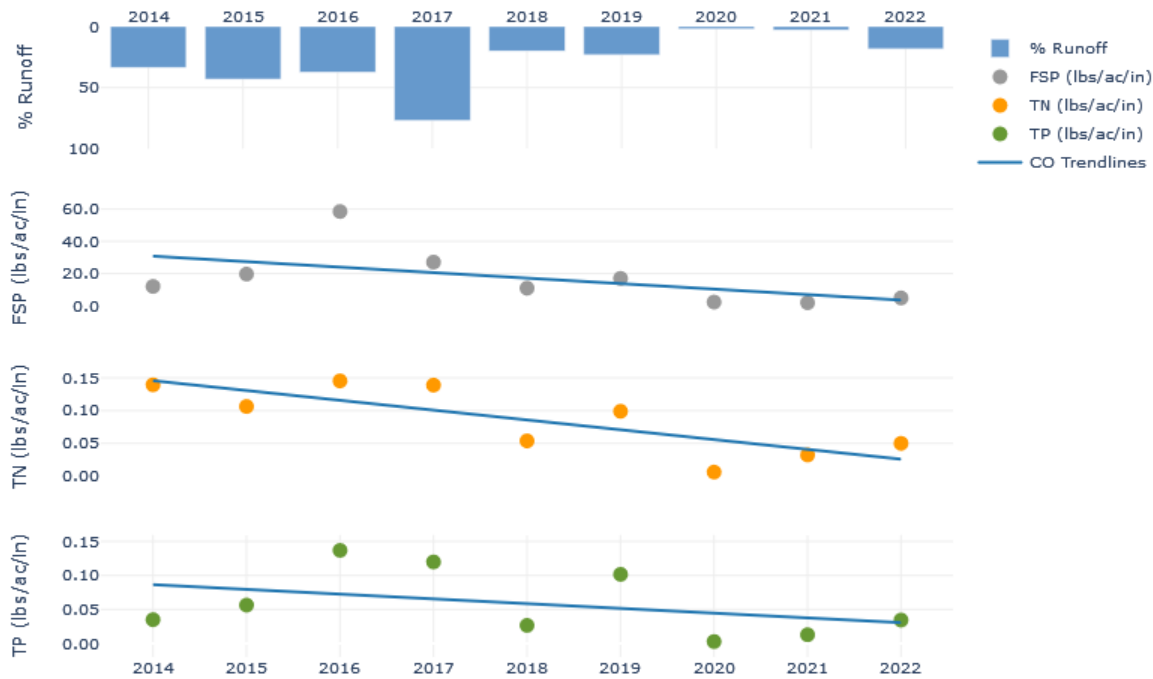


Figure 8 9-year rainfall normalized annual pollutant load trends in FSP, TN, and TP loads at the Contech MFS Outflow, WY14-22.

- Percent runoff varied between 1.9% in WY21 to 76.9% in WY17.
- Differences in % runoff between CI and CO are due to the holding capacity of the Contech MFS vault.
- There is no significant trend in normalized annual FSP loads ($p > 0.05$). There is a significant trend in the normalized seasonal fall/winter FSP Loads ($p = 0.028$ and $\text{Tau} = -0.592$).
- There is a significant trend in normalized annual TN loads ($p = 0.022$ and $\text{Tau} = -0.611$). There is also a significant trend in the normalized seasonal fall/winter TN Loads ($p = 0.046$ and $\text{Tau} = -0.535$).
- There is no significant trend in normalized annual TP loads ($p > 0.05$).
- Significant trends in normalized loads may indicate improved maintenance of the Contech MFS vault.

Table 7 9-year seasonal and annual rainfall normalized pollutant loads at the Contech MFS Outflow, WY14-22.

Year	% Runoff	FSP (lbs/acre/inch)				TN (lbs/acre/inch)				TP (lbs/acre/inch)			
		Fall/Winter	Spring	Summer	Annual	Fall/Winter	Spring	Summer	Annual	Fall/Winter	Spring	Summer	Annual
2014	33.4%	5.379	24.072	13.952	12.066	0.049	0.148	0.340	0.139	0.012	0.065	0.054	0.035
2015	43.0%	21.341	26.666	4.092	19.693	0.095	0.119	0.120	0.106	0.062	0.071	0.018	0.056
2016	37.3%	51.444	73.789	0.000	58.555	0.115	0.207	0.000	0.145	0.115	0.181	0.000	0.137
2017	76.9%	14.183	88.657	9.395	27.130	0.063	0.500	0.041	0.139	0.041	0.494	0.016	0.120
2018	19.8%	12.986	9.207	11.693	10.958	0.063	0.025	0.325	0.054	0.048	0.005	0.076	0.027
2019	23.1%	4.984	56.048	9.371	17.041	0.041	0.271	0.163	0.099	0.028	0.340	0.060	0.102
2020	1.9%	0.000	0.000	24.274	2.351	0.000	0.000	0.063	0.006	0.000	0.000	0.030	0.003
2021	2.7%	0.000	8.591	3.190	1.971	0.000	0.069	0.271	0.032	0.000	0.051	0.036	0.013
2022	18.3%	1.630	20.140	5.956	4.877	0.027	0.098	0.149	0.050	0.014	0.129	0.042	0.034
Tau	na	-0.592	-0.278	-0.056	-0.500	-0.535	-0.222	0.000	-0.611	-0.423	-0.056	0.167	-0.333
P-Value	na	0.028	0.297	0.835	0.061	0.046	0.404	1.000	0.022	0.116	0.835	0.532	0.211
Theil Slope (per year)	na	-2.827	-3.364	-0.081	-2.933	-0.011	-0.012	0.000	-0.016	-0.008	-0.002	0.003	-0.006

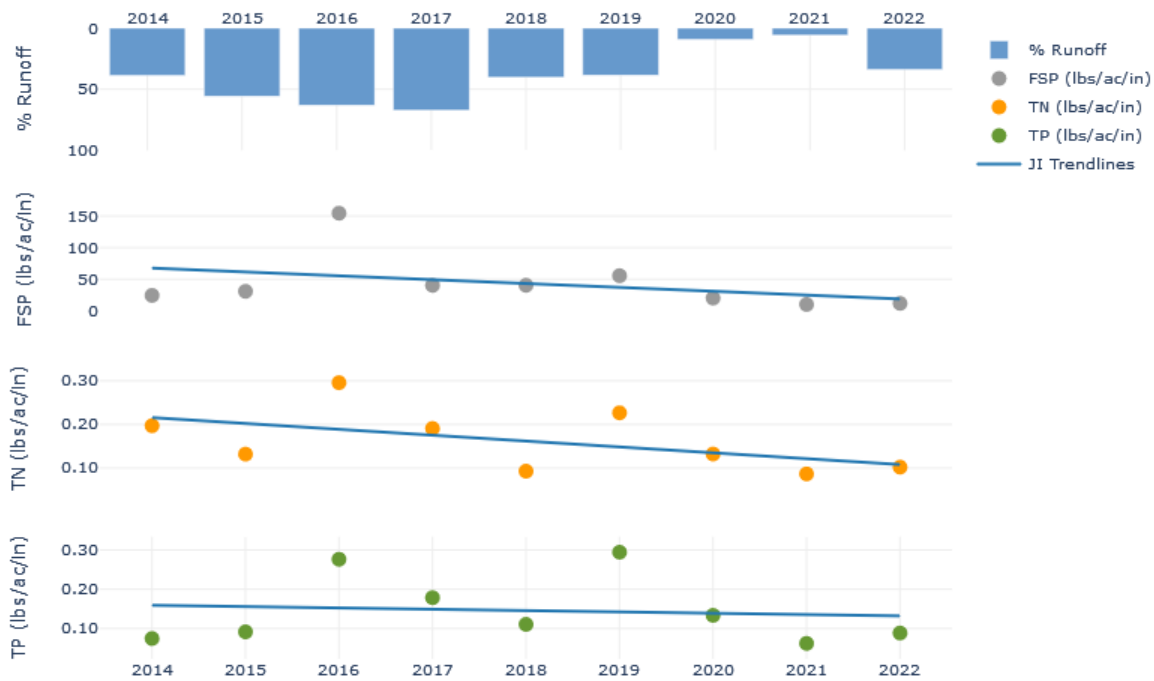


Figure 9 9-year rainfall normalized annual pollutant load trends in FSP, TN, and TP loads at the Jellyfish Inflow, WY14-22.

- Percent runoff varied between 5.7% in WY21 to 67.2% in WY17. Differences in % runoff between CI and JI are attributed to sediment accumulation in the splitter chamber that caused an unequal division of runoff to each vault.
- There is no significant trend in normalized annual FSP loads ($p > 0.05$), however, there is a significant decreasing trend in the normalized fall/winter FSP load ($p = 0.022$ and $\text{Tau} = -0.611$.)
- There is no significant trend in normalized annual TN loads ($p > 0.05$).
- There is no significant trend in normalized annual TP loads ($p > 0.05$).

Table 8 9-year seasonal and annual rainfall normalized pollutant loads at the Jellyfish Inflow, WY14-22.

Year	% Runoff	FSP (lbs/acre/inch)				TN (lbs/acre/inch)				TP (lbs/acre/inch)			
		Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual
2014	38.6%	13.733	51.563	18.989	24.558	0.060	0.313	0.384	0.197	0.033	0.160	0.075	0.075
2015	55.5%	30.438	46.614	8.065	31.038	0.116	0.174	0.109	0.132	0.095	0.133	0.017	0.092
2016	62.9%	117.285	228.200	0.000	154.437	0.214	0.457	0.000	0.296	0.223	0.385	0.000	0.276
2017	67.2%	19.818	137.664	15.455	40.456	0.096	0.643	0.061	0.191	0.065	0.714	0.033	0.179
2018	40.2%	20.067	59.455	18.262	40.577	0.072	0.076	0.526	0.093	0.070	0.146	0.105	0.111
2019	38.3%	12.118	199.427	9.225	55.670	0.090	0.649	0.263	0.227	0.059	1.068	0.071	0.294
2020	9.1%	7.699	43.672	29.192	20.335	0.034	0.172	0.630	0.132	0.057	0.263	0.221	0.134
2021	5.7%	2.562	32.779	26.575	10.351	0.011	0.166	0.672	0.087	0.016	0.183	0.197	0.062
2022	33.8%	3.407	54.852	10.986	11.976	0.060	0.253	0.189	0.102	0.039	0.331	0.094	0.089
Tau	na	-0.611	-0.222	0.222	-0.278	-0.500	-0.111	0.333	-0.389	-0.444	0.222	0.444	-0.056
P-Value	na	0.022	0.404	0.404	0.297	0.061	0.677	0.211	0.144	0.095	0.404	0.095	0.835
Theil Slope (per year)	na	-4.102	-2.495	1.392	-3.085	-0.010	-0.003	0.041	-0.014	-0.008	0.015	0.017	-0.001

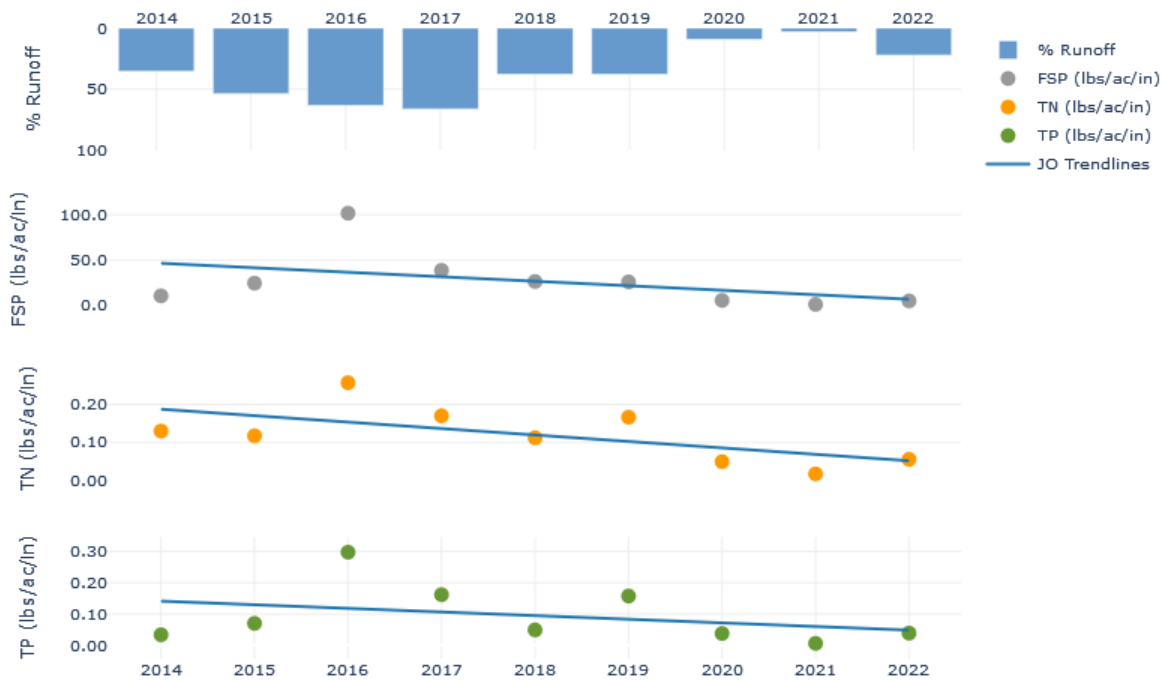


Figure 10 9-year rainfall normalized annual pollutant load trends in FSP, TN, and TP loads at the Jellyfish Outflow, WY14-22.

- Percent runoff varied between 2.7% in WY21 to 66.1% in WY17.
- Differences in % runoff between JI and JO are due to the holding capacity of the Jellyfish vault.
- There is no significant trend in normalized annual FSP loads ($p > 0.05$). There is a significant trend in the normalized seasonal fall/winter FSP Loads ($p = 0.037$ and $\text{Tau} = -0.556$).
- There is no significant trend in normalized annual TN loads ($p > 0.05$).
- There is no significant trend in normalized annual TP loads ($p > 0.05$).
- Significant trends in normalized loads may indicate improved maintenance of the Jellyfish vault.

Table 9 9-year seasonal and annual rainfall normalized pollutant loads at the Jellyfish Outflow, WY14-22.

Year	% Runoff	FSP (lbs/acre/inch)				TN (lbs/acre/inch)				TP (lbs/acre/inch)			
		Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual	Fall/ Winter	Spring	Summer	Annual
2014	35.3%	3.083	22.706	15.463	10.860	0.031	0.134	0.355	0.130	0.008	0.062	0.062	0.034
2015	53.6%	25.300	36.630	4.932	24.843	0.090	0.172	0.110	0.118	0.075	0.094	0.020	0.070
2016	63.1%	71.162	161.372	0.000	101.704	0.149	0.465	0.000	0.257	0.142	0.593	0.000	0.297
2017	66.1%	17.727	138.446	14.408	38.923	0.085	0.578	0.036	0.170	0.054	0.673	0.014	0.162
2018	37.7%	17.617	34.894	17.625	26.646	0.092	0.104	0.432	0.113	0.059	0.036	0.110	0.049
2019	37.7%	9.904	80.714	5.312	26.244	0.078	0.424	0.300	0.166	0.051	0.509	0.043	0.157
2020	9.0%	3.712	11.625	2.770	5.942	0.024	0.079	0.123	0.050	0.023	0.074	0.025	0.038
2021	2.7%	0.384	2.610	10.160	1.492	0.004	0.044	0.090	0.018	0.003	0.016	0.017	0.006
2022	22.0%	0.979	26.676	5.393	5.324	0.025	0.148	0.147	0.056	0.013	0.167	0.041	0.039
Tau	na	-0.556	-0.333	-0.056	-0.444	-0.444	-0.278	0.000	-0.500	-0.444	-0.111	0.000	-0.278
P-Value	na	0.037	0.211	0.835	0.095	0.095	0.297	1.000	0.061	0.095	0.677	1.000	0.297
Theil Slope (per year)	na	-3.818	-5.336	-0.392	-4.171	-0.013	-0.013	0.000	-0.015	-0.010	-0.006	0.000	-0.006

3. Provide mass loading v. volume calculations for select events

Seasonal Progress Report #3 provides this analysis for events that occurred in the fall/winter and spring of water year 2016. Seasonal Progress Report #1 included a similar study based on four events that occurred in the late spring and early summer of water year 2015. Analyses have consistently shown that in general, turbidities (and thus FSP) mirror the flow and therefore no first flush phenomenon exists at SR431 with respect to FSP. This may indicate that the primary road serves as a constant source of sediment. Due to consistent results this analysis has not been repeated since Seasonal Progress Report #3. This analysis can be repeated upon request.

Appendix A

Hydrographs, continuous turbidity, and sample distribution for all sampled events.

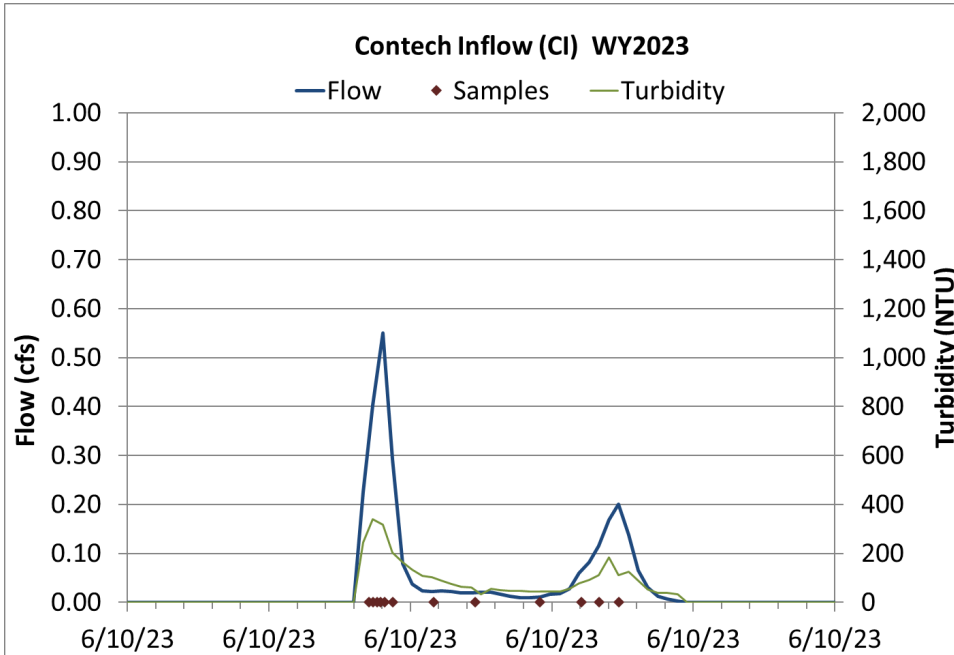


Figure 11 Hydrograph, continuous turbidity, and sample distribution at the Contech Inflow for the 6/10/2023 thunderstorm event.

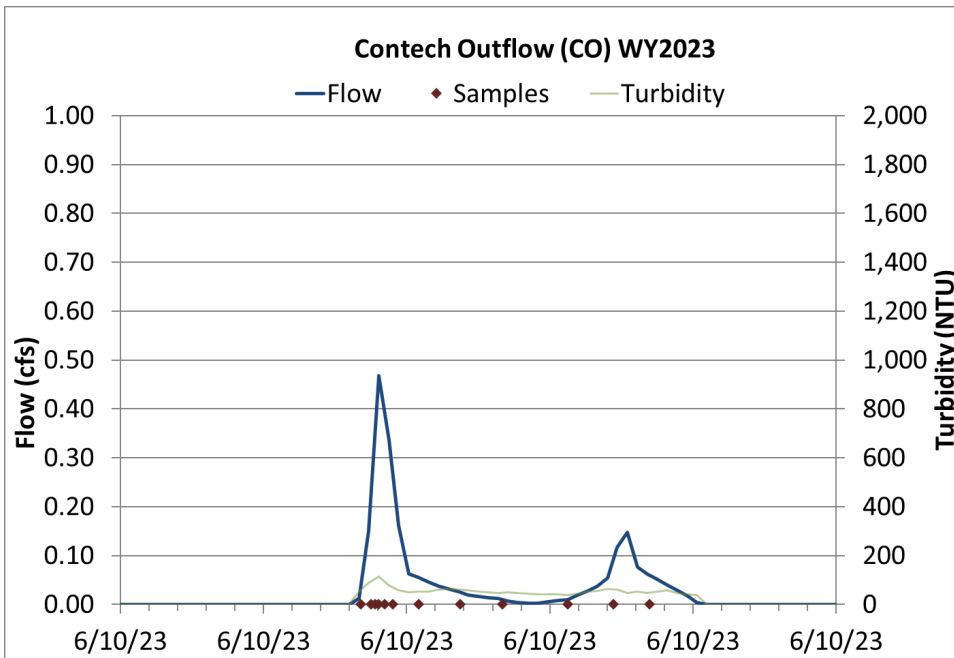


Figure 12 Hydrograph, continuous turbidity, and sample distribution at the Contech Outflow for the 6/10/2023 thunderstorm event.

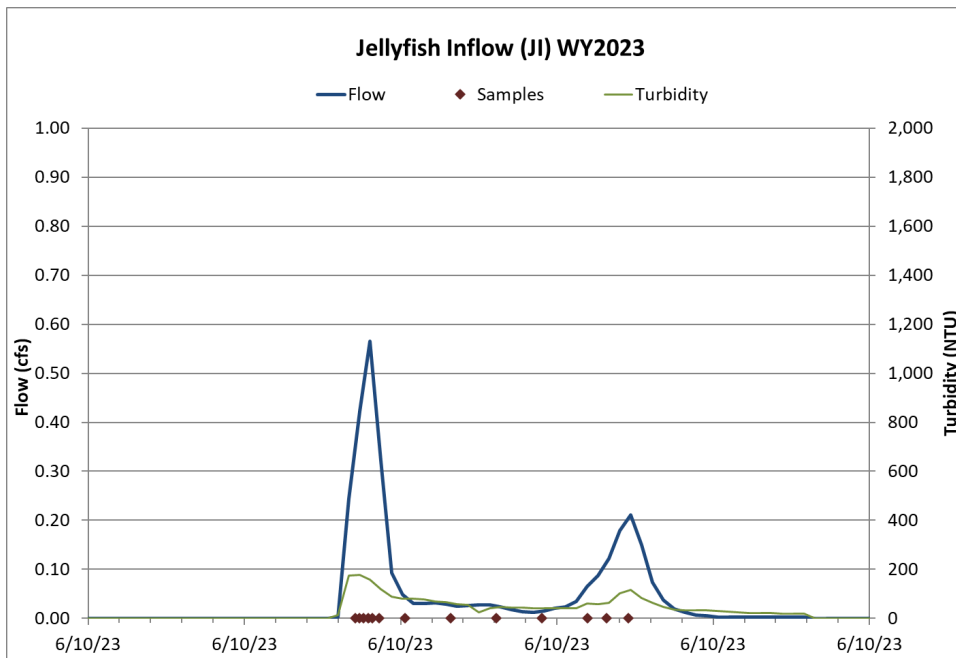


Figure 13 Hydrograph, continuous turbidity, and sample distribution at the Jellyfish Inflow for the 6/10/2023 thunderstorm event.

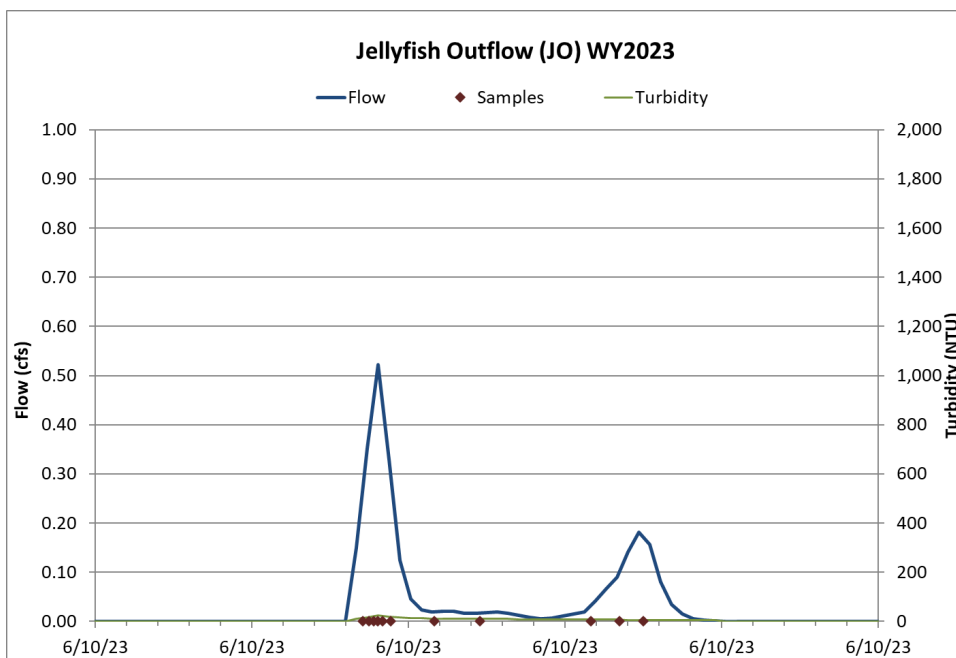


Figure 14 Hydrograph continuous turbidity, and sample distribution at the Jellyfish Outflow for the 6/10/2023 thunderstorm event.

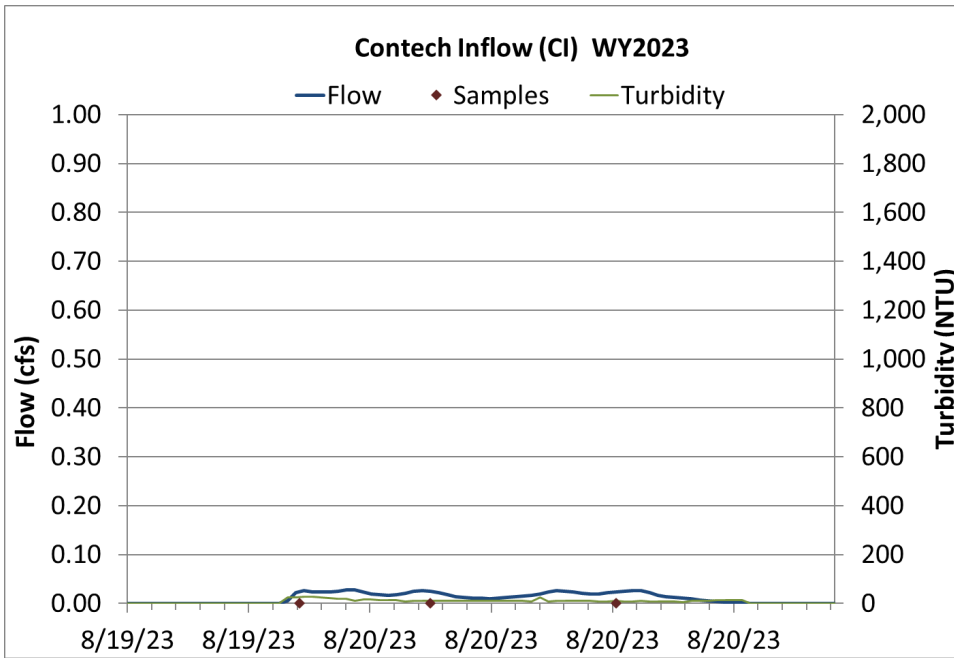


Figure 15 Hydrograph, continuous turbidity, and sample distribution at the Contech Inflow for the 8/19/23-8/20/23 thunderstorm event.

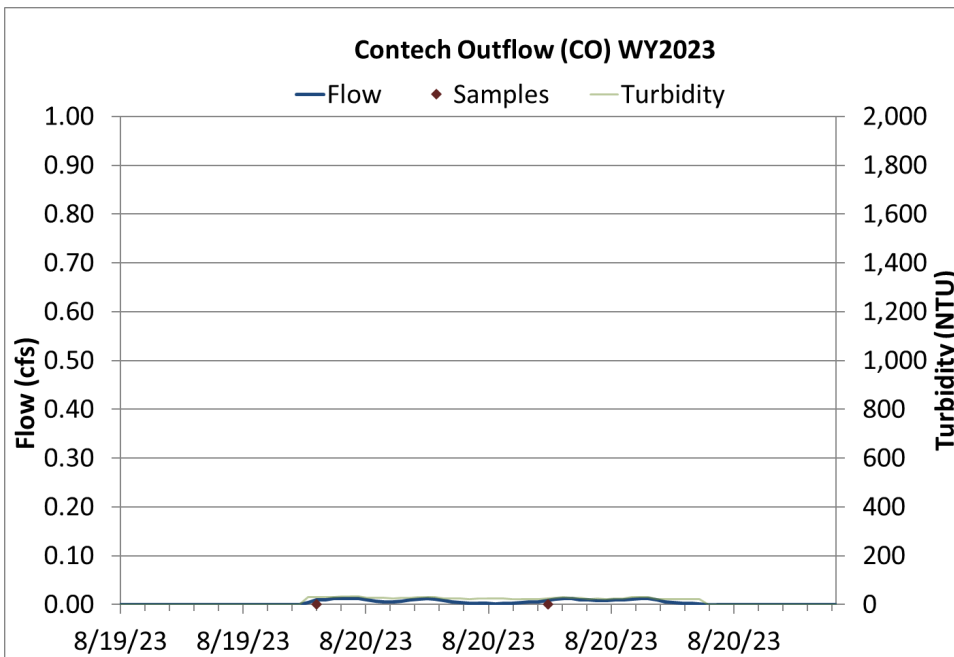


Figure 16 Hydrograph, continuous turbidity, and sample distribution at the Contech Outflow for the 8/19/23-8/20/23 thunderstorm event.

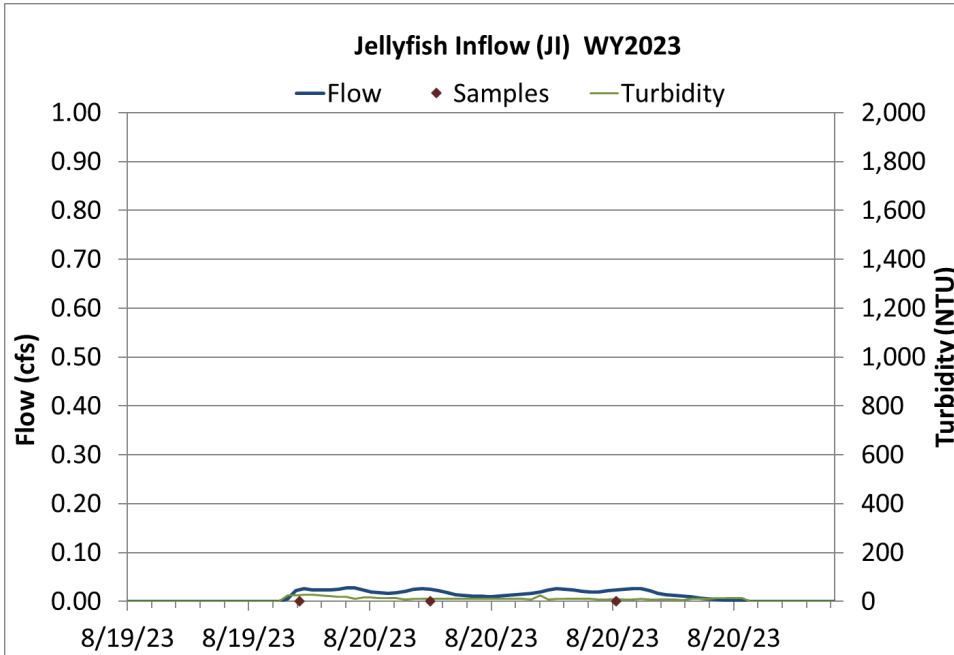


Figure 17 Hydrograph, continuous turbidity, and sample distribution at the Jellyfish Inflow for the 8/19/23-8/20/23 thunderstorm event.

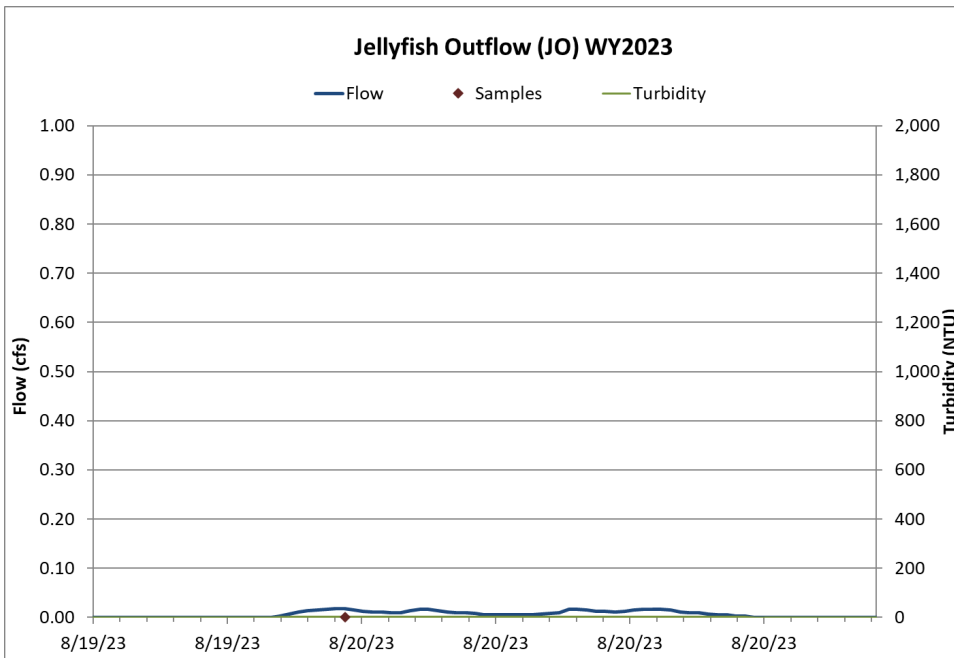


Figure 18 Hydrograph, continuous turbidity, and sample distribution at the Jellyfish Outflow for the 8/19/23-8/20/23 thunderstorm event.

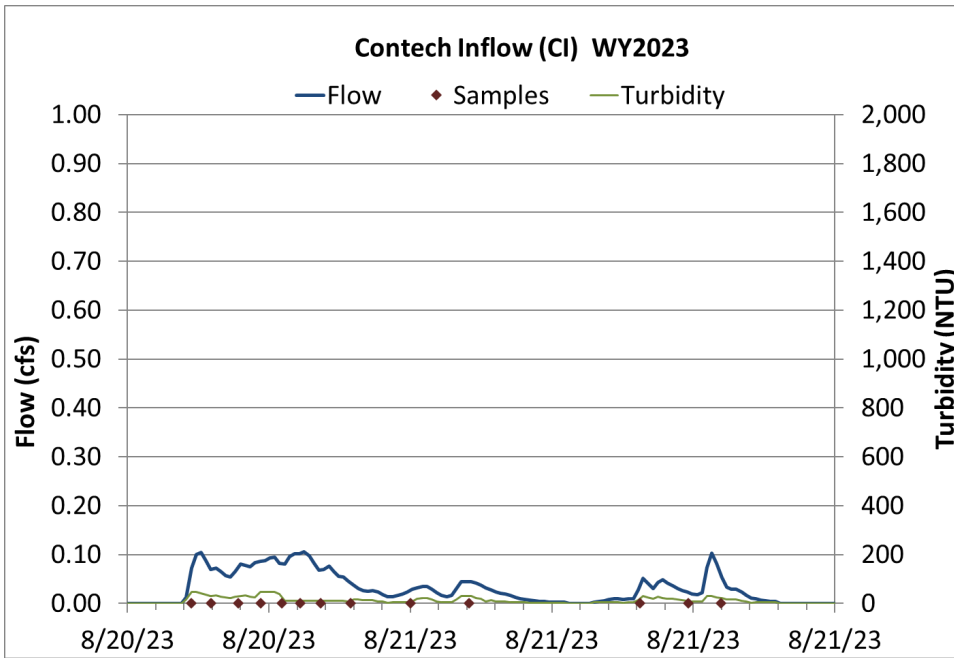


Figure 19 Hydrograph, continuous turbidity, and sample distribution at the Contech Inflow for the 8/20/23-8/21/23 rain event.

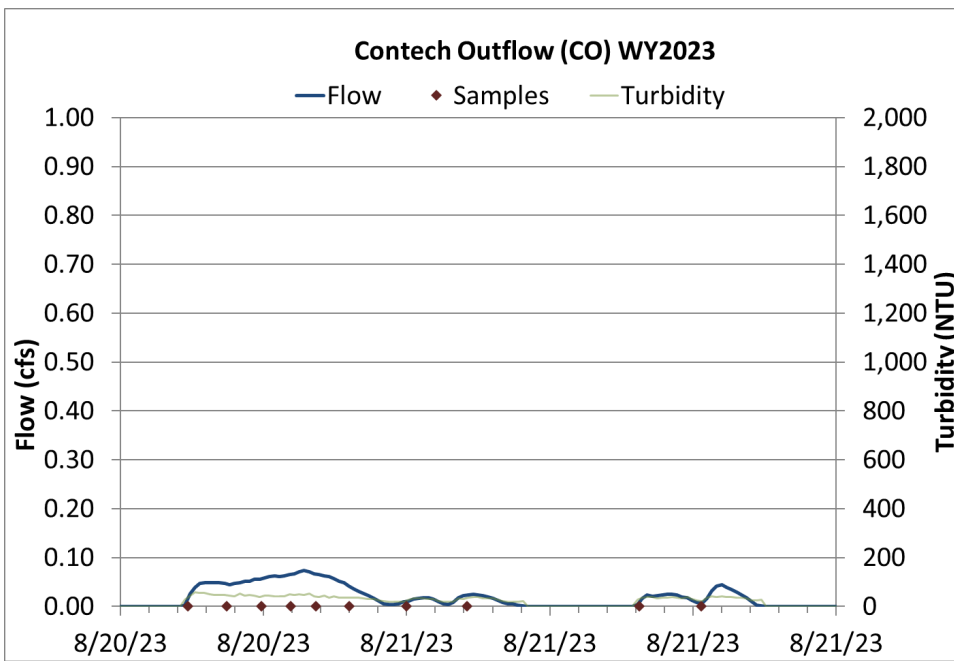


Figure 20 Hydrograph, continuous turbidity, and sample distribution at the Contech Outflow for the 8/20/23-8/21/23 rain event.

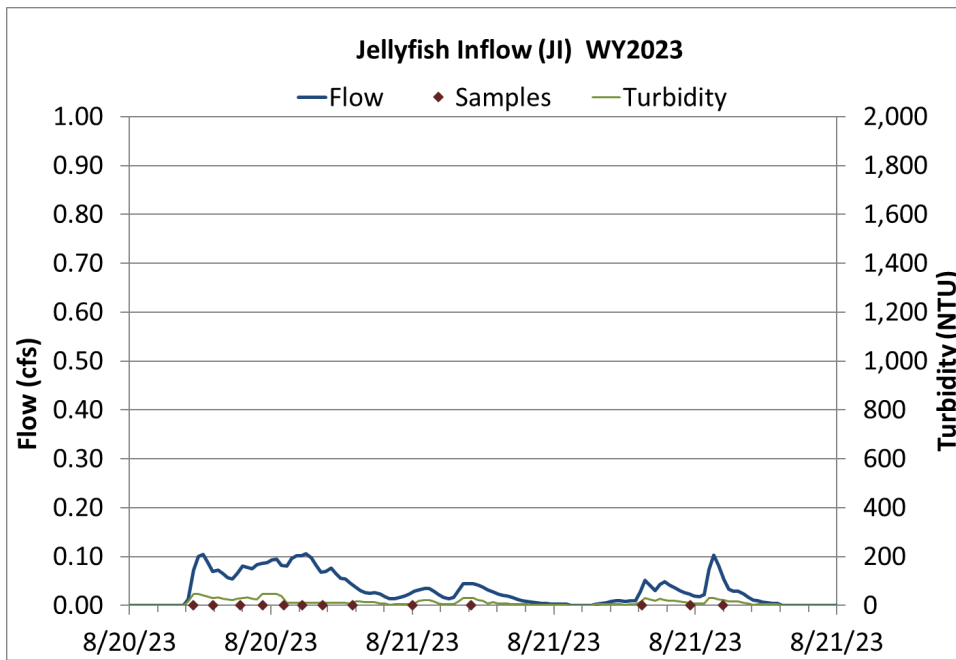


Figure 21 Hydrograph, continuous turbidity, and sample distribution at the Jellyfish Inflow for the 8/20/23-8/21/23 rain event.

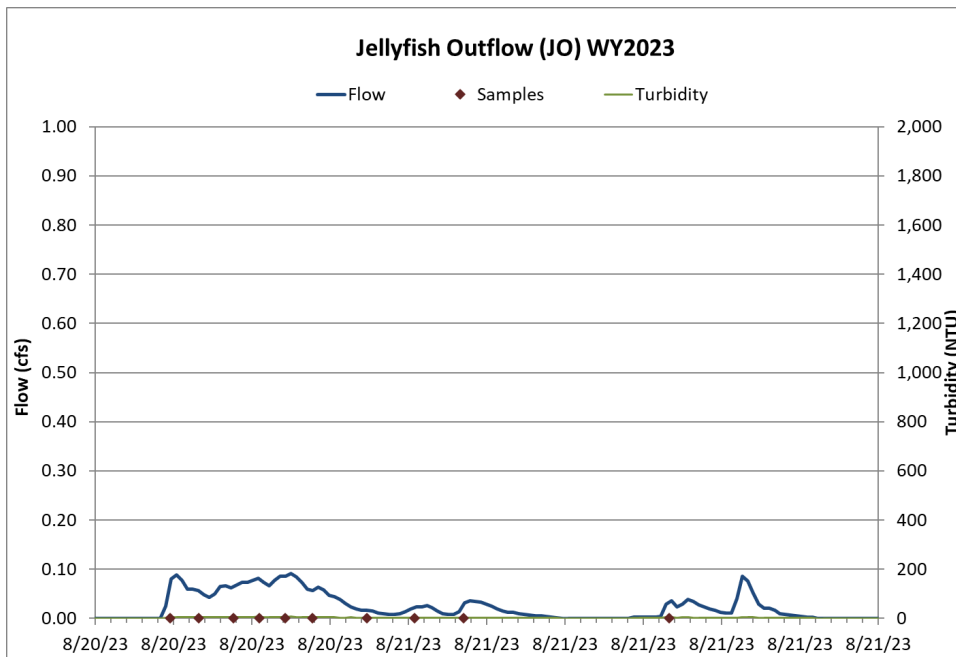


Figure 22 Hydrograph, continuous turbidity, and sample distribution at the Jellyfish Outflow for the 8/20/23-8/21/23 rain event.

References

2NDNATURE, Desert Research Institute. 2014. Surrogate Indicators to Monitor Fine Sediment Particles in the Lake Tahoe Basin. March 2014.

2NDNATURE LLC, Northwest Hydraulic Consultants, Environmental Incentives, 2010. *Road RAM Technical Document*. Prepared for the Nevada Division of Environmental Protection and California Tahoe Conservancy. November 2010.

Tahoe Resource Conservation District, 2NDNATURE, Desert Research Institute, Northwest Hydraulic Consultants. 2017. *Updated RSWMP Framework and Implementation Guidance Document*. Submitted the California State Water Board. March 30, 2015. Updated October 31, 2017.